



ALL INFORMATION CONTAINED HEREIN IS THE PROPERTY OF SPRINGLINE ARCHITECTS L.L.C. THE CONCEPTS, IDEAS, DESIGNS AND DETAILS AS SHOWN ON THE DOCUMENTS WERE CREATED, DEVELOPED, AND PRESENTED FOR USE ON THIS SPECIFIC PROJECT AND SHALL NOT BE REUSED FOR ANY PURPOSE WITHOUT THE WRITTEN CONSENT OF SPRINGLINE ARCHITECTS L.L.C. THE OWNER SHALL BE PERMITTED TO RETAIN COPIES FOR INFORMATION AND REFERENCE PURPOSES ONLY.

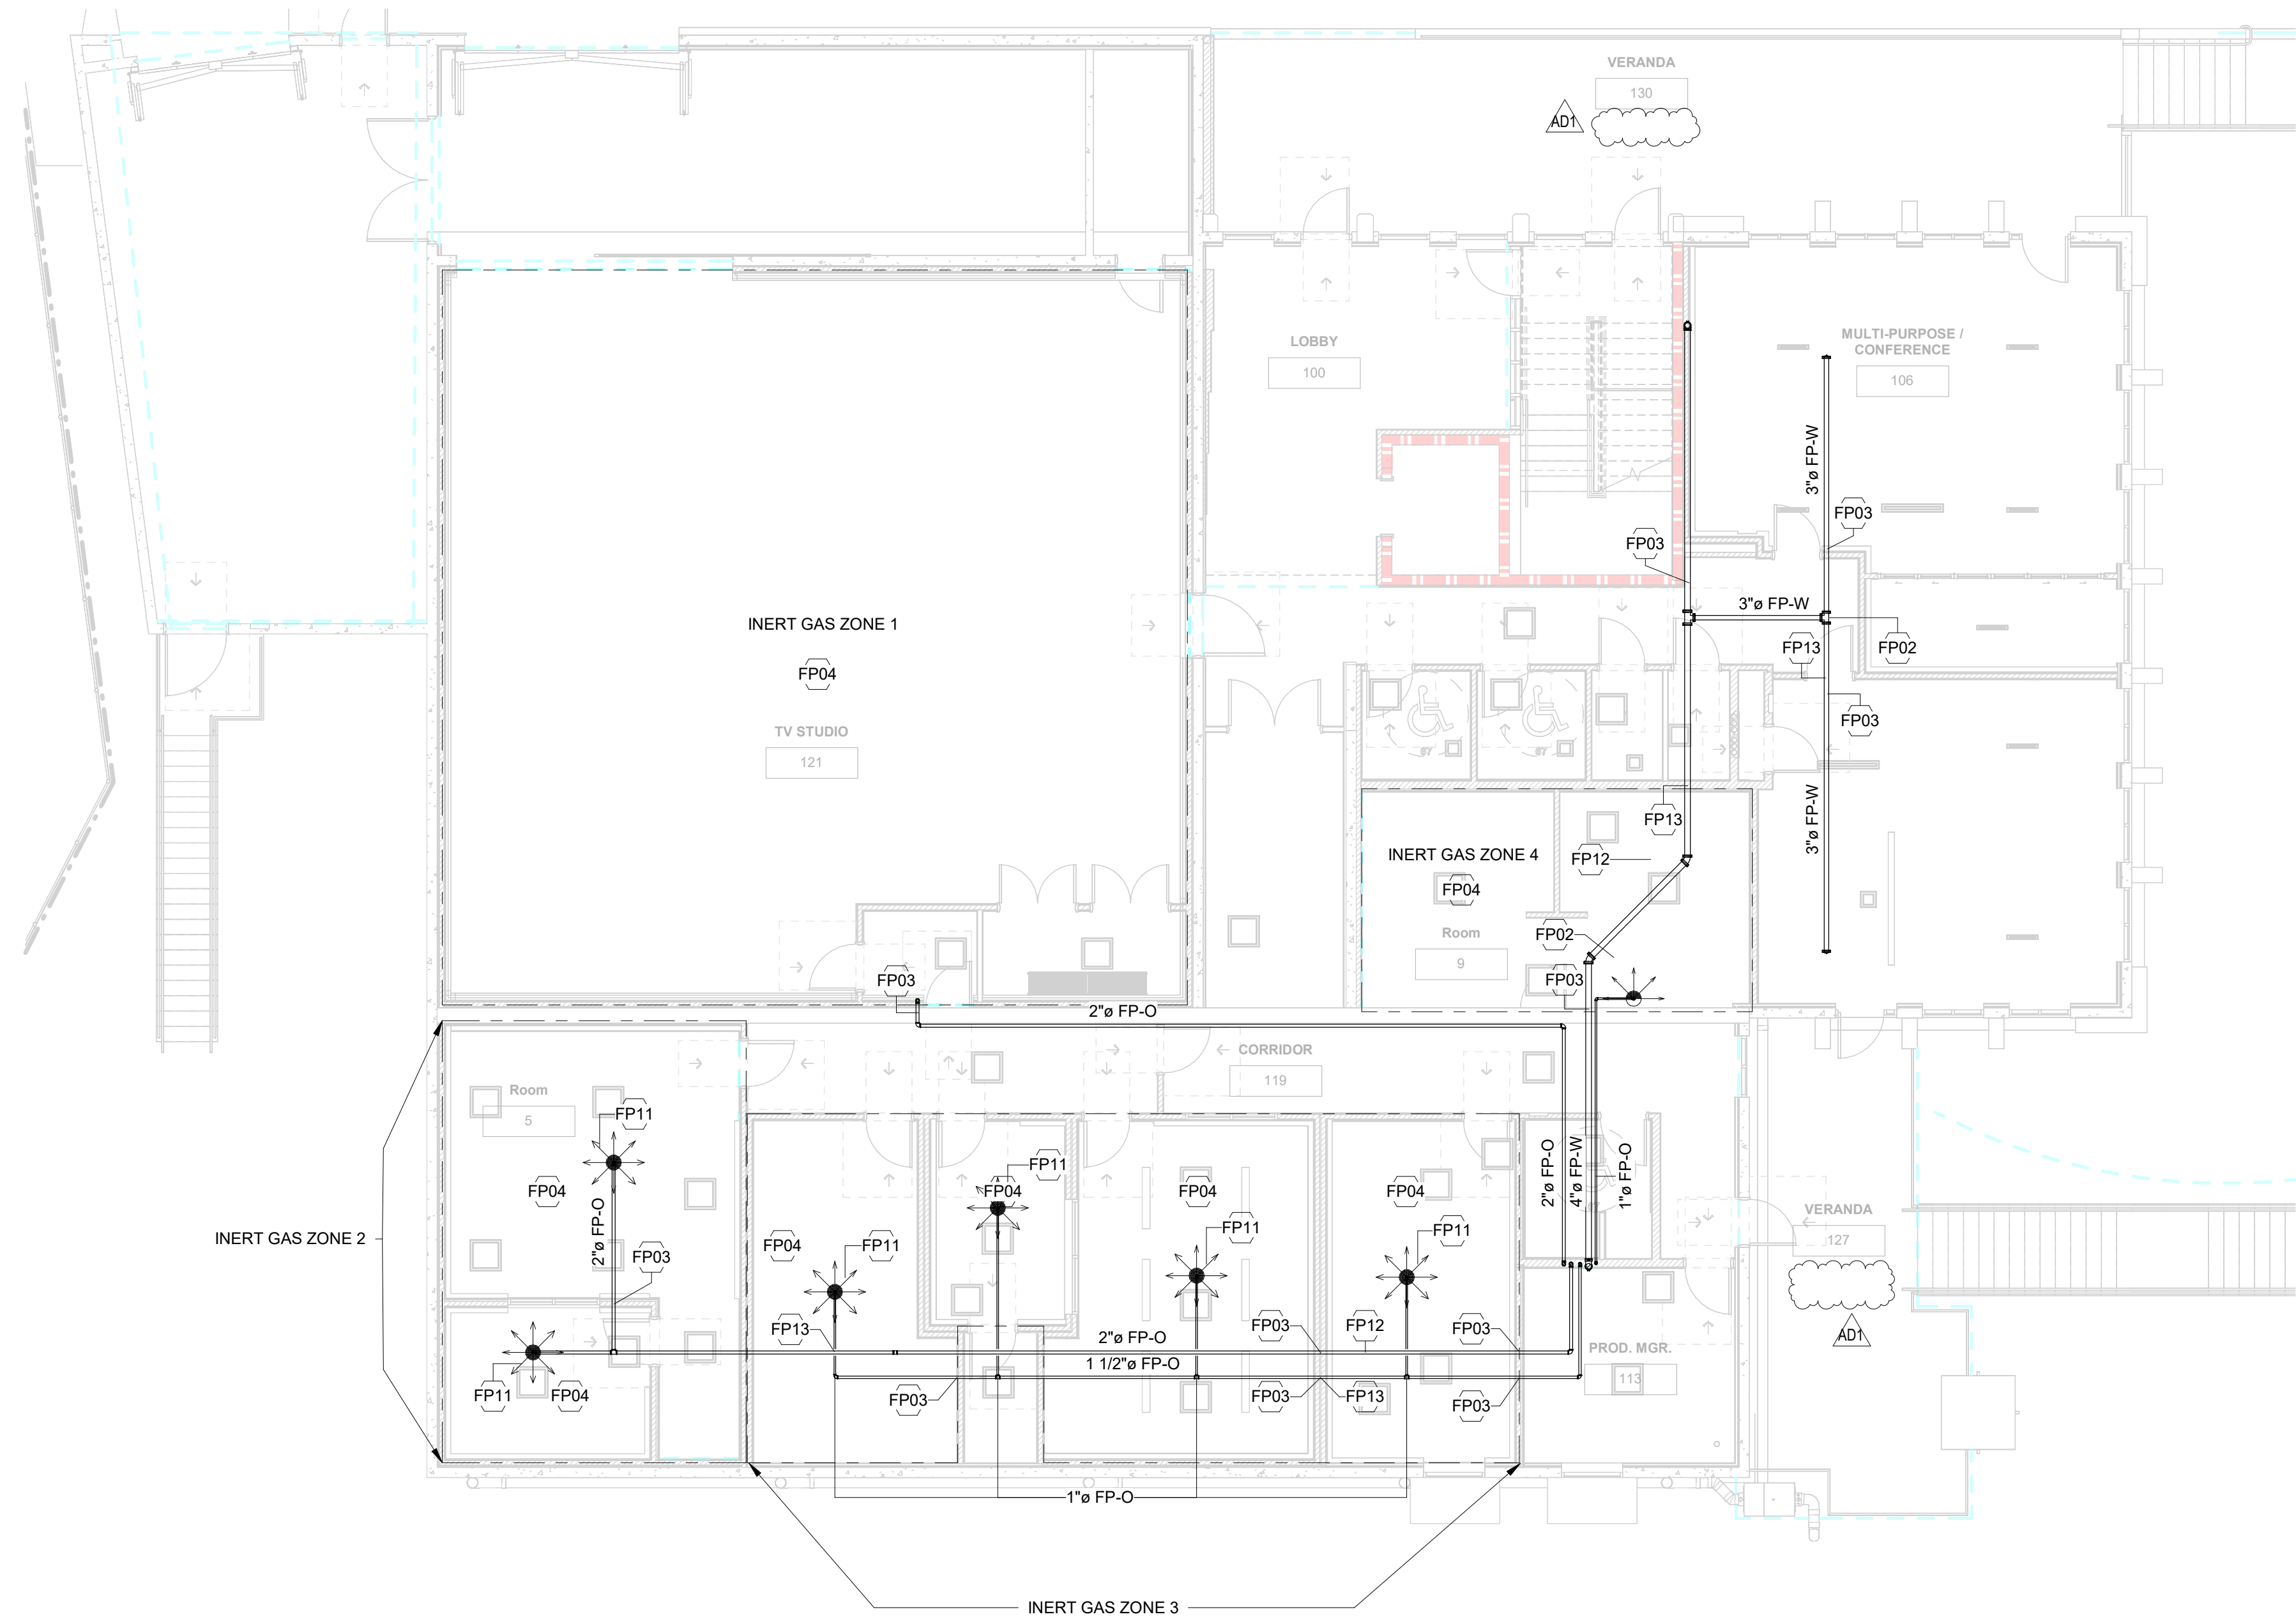

1
FP101
1/8" = 1'-0"

Keystone Legend	
Key Value	Keystone Text
FP02	PROPOSED ROUTING OF FIRE PROTECTION PIPE. CONTRACTOR IS TO COORDINATE THE INSTALLATION AS TO AVOID CONFLICTS WITH OTHER TRADES.
FP03	PIPE PENETRATES AN ACOUSTICALLY TREATED ROOM, AND THEREFORE MUST BE SEALED ACCORDING TO THE ACOUSTIC REPORT.
FP04	ROOM IS TO BE SERVED BY A POSITIVE PRESSURE INERT GAS SYSTEM. FINAL VENTILATION SIZE IS TO BE CALCULATED BY A LICENSED PROFESSIONAL.
FP11	ALL SPRINKLERS ARE TO BE CENTERED IN FINISHED CEILINGS. TYP.
FP12	ALL FIRE PROTECTION PIPES ARE TO BE INSTALLED ABOVE THE ACOUSTIC CEILING, WHERE APPLICABLE, AND ALL PENETRATIONS THROUGH ACOUSTIC CEILING ARE TO BE SEALED PER ACOUSTIC REPORT. TYP. REFER TO A400 FOR ALL APPLICABLE CONDITIONS.
FP13	CONTRACTOR IS TO COORDINATE ALL PIPE INSTALLATION WITH ELECTRICAL TRAYS TO AVOID CONFLICTS. TYP.

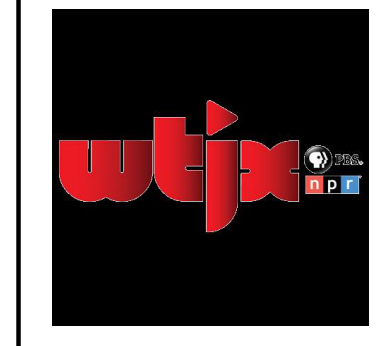

WTJX Radio Station
 Haypiece Hill, Parcels 158A and 158 Rem
 Submarine base, St. Thomas USVI

FIRE PROTECTION FIRST FLOOR PLAN

REVISIONS:		
No.	Description	Date
AD1	Addendum 1	3/7/2025

DRAWN BY: _____ Author
 CHECKED BY: _____ Checker
 DATE: April 26, 2024
 NOVUS JOB NUMBER
 201

SHEET NUMBER
FP101

CONSTRUCTION DOCUMENTS